

WAYNE COUNTY WATER AND SEWER AUTHORITY
3377 Daansen Road, Walworth, NY 14568

WATER SERVICE APPLICATION AND CONTRACT
WESTERN

Owner of Property _____
 Address of Connection _____
 Billing Address _____
 Agent/contractor _____ Address _____
 Phone Number(s): Owner _____ Agent _____

In consideration of the acceptance of this application, the undersigned, his agent, successors and assigns agree:

To accept and abide by all provisions of the "Rules and Regulation for the Management and Protection of the Wayne County Water and Sewer Authority," and all other pertinent ordinances or regulations that may be adopted in the future.

To maintain the building water service from the building to the lot line or easement at no expense to the Authority. All material and work from the water main to the property line or edge of easement will be furnished and installed by the Wayne County Water and Sewer Authority within the public highway or easement and a water meter will be installed on the premises.

Application must be made and signed by owner of the property or his agent, and full payment must be made to the Wayne County Water and Sewer Authority before work can begin.

Owner must deposit with the Wayne County Water and Sewer Authority the amount specified below as security for amounts that may become due, including water rents and other fees and charges. If owner fails to pay any amount when due, the Authority may apply the deposit toward the amounts due. Any unused deposit will be returned to owner when water service is terminated.

Owner agrees to pay all costs, and fees, including reasonable attorney's fees at any time paid or incurred by the Authority in endeavoring to collect amounts due to the Authority from owner.

***Additional expenses** will be billed for rock removal and/or abnormal conditions for water service installation. **These charges** will be in addition to the normal cost. Customer will be apprised of conditions, if warranted.

Date _____ Signed _____

Wayne County Water and Sewer Authority Fee Schedule Adopted June 1, 2005

| | |
|--|--|
| _____ 1" Service, 3/4" meter | \$1,200.00 |
| _____ 1" service, 1" Meter | \$1,300.00 |
| _____ 1-1/2" Service, 1" Meter | \$1,700.00 (additional charge for larger than 1" meter, based on current prices) |
| _____ 2" Service, 1" Meter | \$1,900.00 (additional charge for larger than 1" meter, based on current prices) |
| _____ 3/4" Meter only | \$ 450.00 |
| _____ 1" Meter only | \$ 550.00 |
| _____ Over 1" Meter only: Specify size _____ | \$ 550.00 plus additional material and labor costs above 1" |

Water Authority Fee: _____ Security Deposit: _____ Total Received: _____ Received by: _____ Date: _____


Building Permit: _____ Account number: _____ Approved by: _____ Date: _____

WAYNE COUNTY WATER & SEWER AUTHORITY
3377 Daansen Road
Walworth, NY 14568
WESTERN SERVICE AREA
TDD #1-800-662-1220

RULES, REGULATIONS AND PROCEDURES GOVERNING SERVICE LINE AND
METER INSTALLATIONS

1. Make application and mail payment to WCWSA, 3377 Daansen Road, Walworth, NY 14568. Application must be signed by the owner of the property.
 - A. The application fee for a 1" water service is \$1200.00. All 1" services will be supplied with meter, angle meter valve, check valve, and pressure regulator.
 - B. The application fee for a ¾" **meter only** is \$450; a 1" **meter only** is \$550.00. All meter installations will be supplied with meter, angle meter valve, check valve, and pressure regulator.
 - C. Services and meters larger than 1" will be addressed on an individual basis by the Authority. A deposit equal to the cost of a 1" service or meter will be required at application.
2. Mark with a stake your desired location of service at the front Right of Way (ROW) line. Work will not start until location has been marked.
3. Approved service line materials 1" through 2"
 - A. High density polyethylene tubing classified as PE 3308 or PE 3408 with 200 psi pressure rating. This material should be the same OD as copper or be stamped CTS (copper tubing size).
 - B. Type K copper tubing.
 - C. Only compression type fittings permissible with copper line.
 - D. Only compression type fittings with stainless steel insert permissible for polyethylene tubing.
4. Installation instructions
 - A. Call the Authority at 315-986-1929 or, if calling long distance, 800-410-1929:
 - i) To arrange for inspection of the line before backfilling
 - ii) To make an appointment for a meter installation
 - iii) A minimum of 24 hours advance notice is required for inspection or meter installation.
 - iv) Inspections and meter installations will be scheduled Monday through Friday between 7:30 a.m. and 3 p.m.
 - B. Water service shall not be installed within 10 feet of any portion of a leach system or any related appurtenances.
 - C. Dig a trench to provide a minimum of 4-1/2 feet of cover over service line curb stop to building entrance.
 - D. Line must be hand covered to a depth of 6" with select fill before mechanically filling trench.
 - E. NOTIFY UNDERGROUND FACILITIES PROTECTIVE ORGANIZATION (UFPO) A MINIMUM OF 2 BUSINESS DAYS IN ADVANCE OF DIGGING BY CALLING 1-800-962-7962.
5. In each case where the building to be served is more than 250 feet from the road, the homeowner may be required to install an individual meter pit at the front property line. The Authority will determine the necessity for a meter pit on an individual basis.

**WAYNE COUNTY WATER AND SEWER AUTHORITY
WATER SERVICE DETAIL**

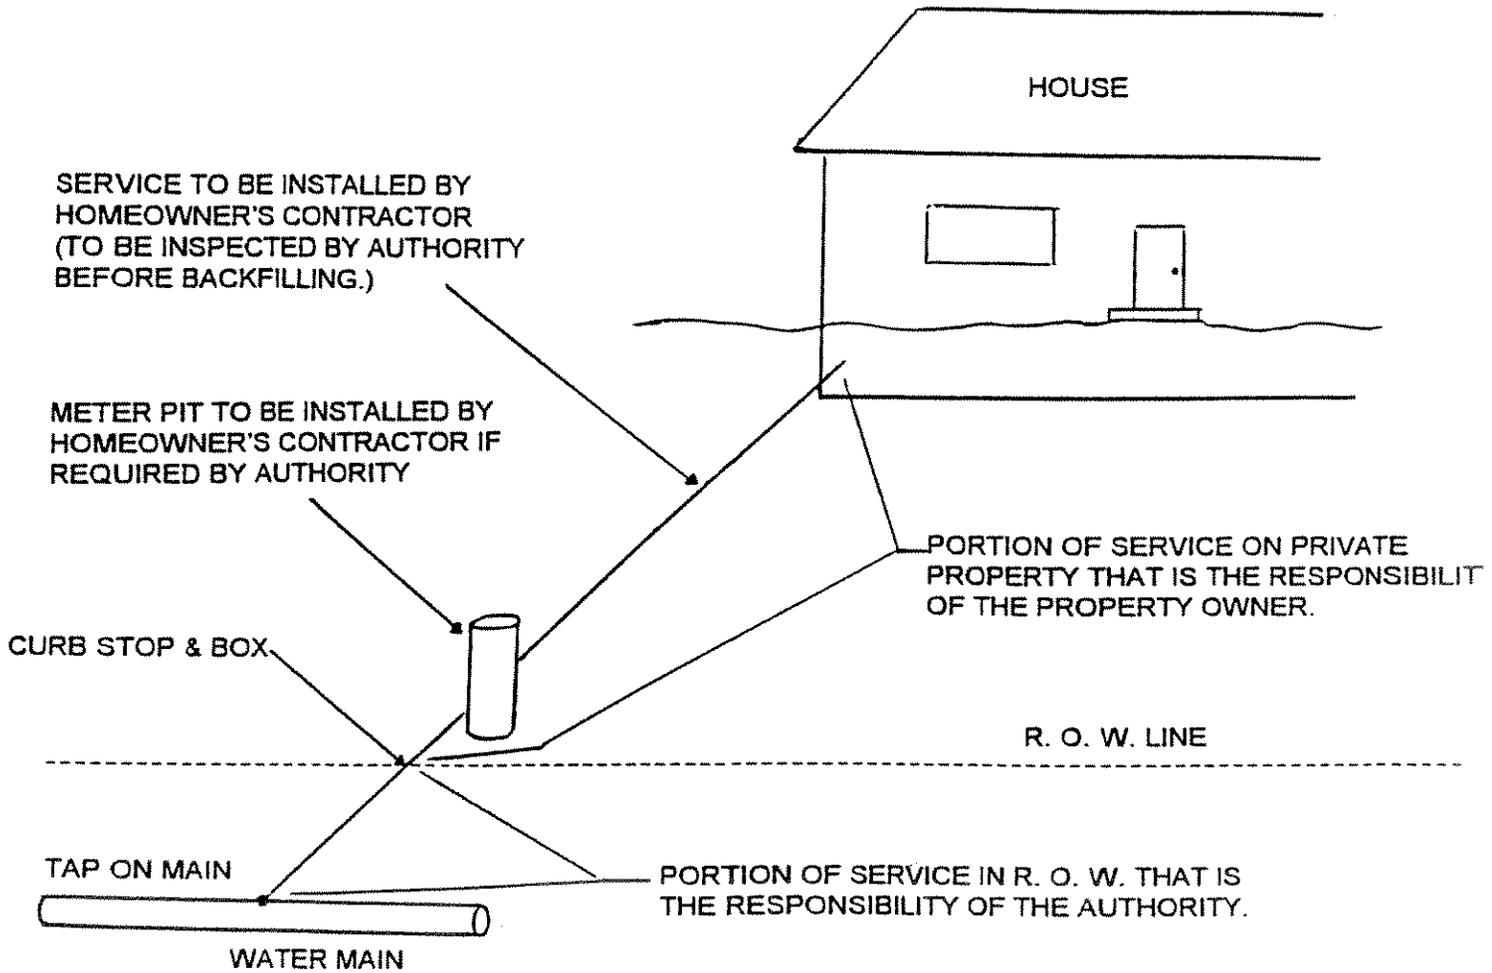

METER INSTALLATION DETAIL

